


AC MODULE ELECTRICAL DIAGRAM

EQUIPMENT SCHEDULE			
TAG	DESCRIPTION	PART NUMBER	NOTES
1			
2			
3			
4			
5			
6			
7			

SEE GUIDE APPENDIX D FOR
INFORMATION ON MODULE AND
ARRAY GROUNDING

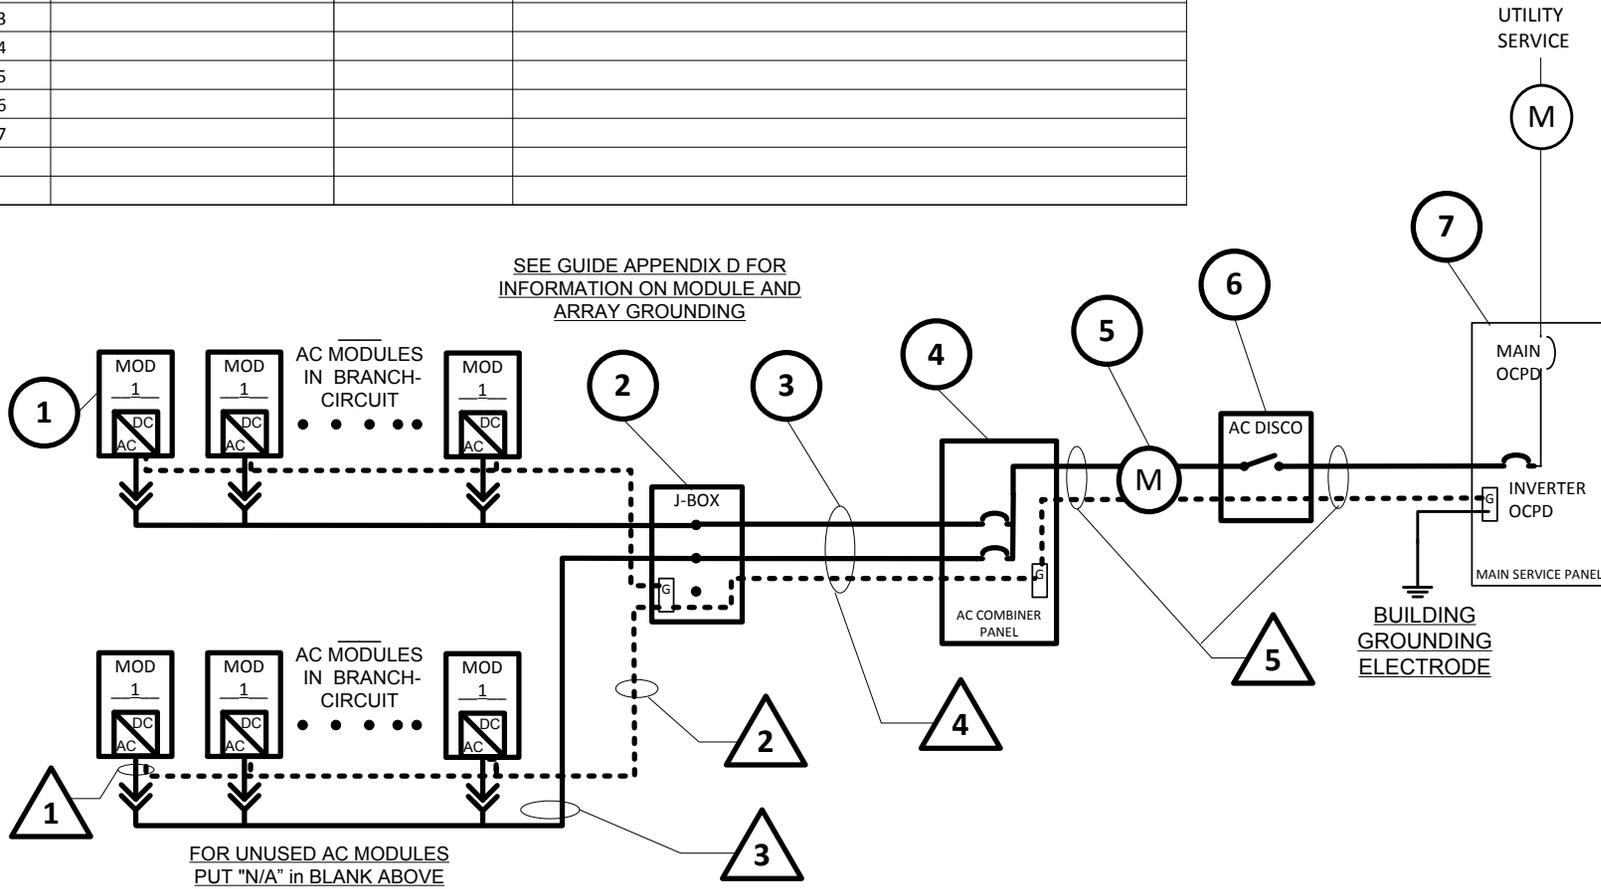

CONDUIT AND CONDUCTOR SCHEDULE					
TAG	DESCRIPTION OR CONDUCTOR TYPE	COND. GAUGE	NUMBER OF CONDUCTORS	CONDUIT TYPE	CONDUIT SIZE
1	USE-2 <input type="checkbox"/> or PV WIRE <input type="checkbox"/>	MFG	MFG Cable	N/A	N/A
2	GEC <input type="checkbox"/> EGC <input type="checkbox"/> X ALL THAT APPLY			N/A	N/A
3	EXTERIOR CABLE LISTED W/ INV.	MFG	MFG Cable	N/A	N/A
4	THWN-2 <input type="checkbox"/> or XHHW-2 <input type="checkbox"/> or RHW-2 <input type="checkbox"/>				
	GEC <input type="checkbox"/> EGC <input type="checkbox"/> X ALL THAT APPLY				
	NO DC GEC IF 690.35 SYSTEM				
5	THWN-2 <input type="checkbox"/> or XHHW-2 <input type="checkbox"/> or RHW-2 <input type="checkbox"/>				
	GEC <input type="checkbox"/> EGC <input type="checkbox"/> X ALL THAT APPLY				

Contractor Name, Address and Phone:	One-Line Standard Electrical Diagram for AC Module PV Systems		
	Site Name:		
	Site Address:		
	System AC Size:		
Drawn By:	SIZE	FSCM NO	DWG NO
Checked By:	SCALE	NTS	Date: SHEET

NOTES FOR AC MODULE ELECTRICAL DIAGRAM

NOTES FOR ALL DRAWINGS:

OCPD = OVERCURRENT PROTECTION DEVICE

NATIONAL ELECTRICAL CODE® REFERENCES SHOWN AS (NEC XXX.XX)

AC MODULE RATINGS (Guide Appendix C)

AC MODULE MAKE	
AC MODULE MODEL	
NOMINAL OPERATING AC VOLTAGE	
NOMINAL OPERATING AC FREQUENCY	
MAXIMUM AC POWER	
MAXIMUM AC CURRENT	
MAXIMUM OCPD RATING	

SIGNS—SEE GUIDE SECTION 7

SIGN FOR DC DISCONNECT

N/A since no dc wiring

SIGN FOR INVERTER OCPD AND AC DISCONNECT (IF USED)

**SOLAR PV SYSTEM
AC POINT OF CONNECTION**

AC OUTPUT CURRENT	
NOMINAL AC VOLTAGE	

THIS PANEL FED BY MULTIPLE SOURCES (UTILITY AND SOLAR)

NOTES FOR ARRAY CIRCUIT WIRING (Guide Section 6 and 8 and Appendix F):

- 1.) LOWEST EXPECT AMBIENT TEMPERATURE BASED ON ASHRAE MINIMUM MEAN EXTREME DRY BULB TEMPERATURE FOR ASHRAE LOCATION MOST SIMILAR TO INSTALLATION LOCATION. LOWEST EXPECTED AMBIENT TEMP ____°C
- 2.) HIGHEST CONTINUOUS AMBIENT TEMPERATURE BASED ON ASHRAE HIGHEST MONTH 2% DRY BULB TEMPERATURE FOR ASHRAE LOCATION MOST SIMILAR TO INSTALLATION LOCATION. HIGHEST CONTINUOUS TEMPERATURE ____°C
- 2.) 2009 ASHRAE FUNDAMENTALS 2% DESIGN TEMPERATURES DO NOT EXCEED 47°C IN THE UNITED STATES (PALM SPRINGS, CA IS 44.1°C). FOR 6 OR LESS CURRENT-CARRYING CONDUCTORS IN ROOF-MOUNTED SUNLIT CONDUIT AT LEAST 0.5" ABOVE ROOF AND USING THE OUTDOOR DESIGN TEMPERATURE OF 47°C OR LESS (ALL OF UNITED STATES),
 - a) 12 AWG, 90°C CONDUCTORS ARE GENERALLY ACCEPTABLE FOR AC MODULES INVERTER OUTPUT CIRCUITS WITH 12 AMPS OR LESS WHEN PROTECTED BY A 15-AMP OR SMALLER OCPD.
 - b) 10 AWG, 90°C CONDUCTORS ARE GENERALLY ACCEPTABLE FOR AC MODULES INVERTER OUTPUT CIRCUITS WITH 16 AMPS OR LESS WHEN PROTECTED BY A 20-AMP OR SMALLER OCPD.

NOTES FOR INVERTER CIRCUITS (Guide Section 8 and 9):

- 1) IF UTILITY REQUIRES A VISIBLE-BREAK SWITCH, DOES THIS SWITCH MEET THE REQUIREMENT? YES NO N/A
- 2) IF GENERATION METER REQUIRED, DOES THIS METER SOCKET MEET THE REQUIREMENT? YES NO N/A
- 3) SIZE PHOTOVOLTAIC POWER SOURCE (DC) CONDUCTORS BASED ON MAX CURRENT ON NEC 690.53 SIGN OR OCPD RATING AT DISCONNECT (N/A)
- 4) SIZE INVERTER OUTPUT CIRCUIT (AC) CONDUCTORS ACCORDING TO INVERTER OCPD AMPERE RATING. (See Guide Section 9)
- 5) TOTAL OF _____ INVERTER OUTPUT CIRCUIT OCPD(S), ONE FOR EACH AC MODULE CIRCUIT. DOES TOTAL SUPPLY BREAKERS COMPLY WITH 120% BUSBAR EXCEPTION IN 690.64(B)(2)(a)? YES NO

Contractor Name, Address and Phone:	Notes for One-Line Standard Electrical Diagram for Single-Phase PV Systems			
	Site Name:			
	Site Address:			
	System AC Size:			
Drawn By: Bill	SIZE	FSCM NO	DWG NO	REV
Checked By: Ted	SCALE	NTS	Date:	SHEET